



Catalog Number:

8824-GSC1-NK

Item Description:

N1 SCREW CVR GUTTER NK

UPC Code:

784572109261

Brand Name: Milbank

Type: Lay In Wireway

Application: Wireway

Standard: UL Listed, Type 1

Cover Type: Screw Cover

Enclosure: Indoor Enclosure

Nominal Cross Section: 8x8

Straight Section Length: 24

Material: Steel with Powder Coat Finish


Finish: ANSI 61 Gray

Knockouts: False



Utility requirements may vary. Always consult the serving utility for their requirements prior to ordering or installing this equipment. This product must always be installed by a licensed electrician. Installation of this equipment may require local electrical inspector approval.


CATALOG#	LABEL#
8824-GSC1-()	1002943
RC-8824-GSC1-()	1125051
SPS-882()	1132575

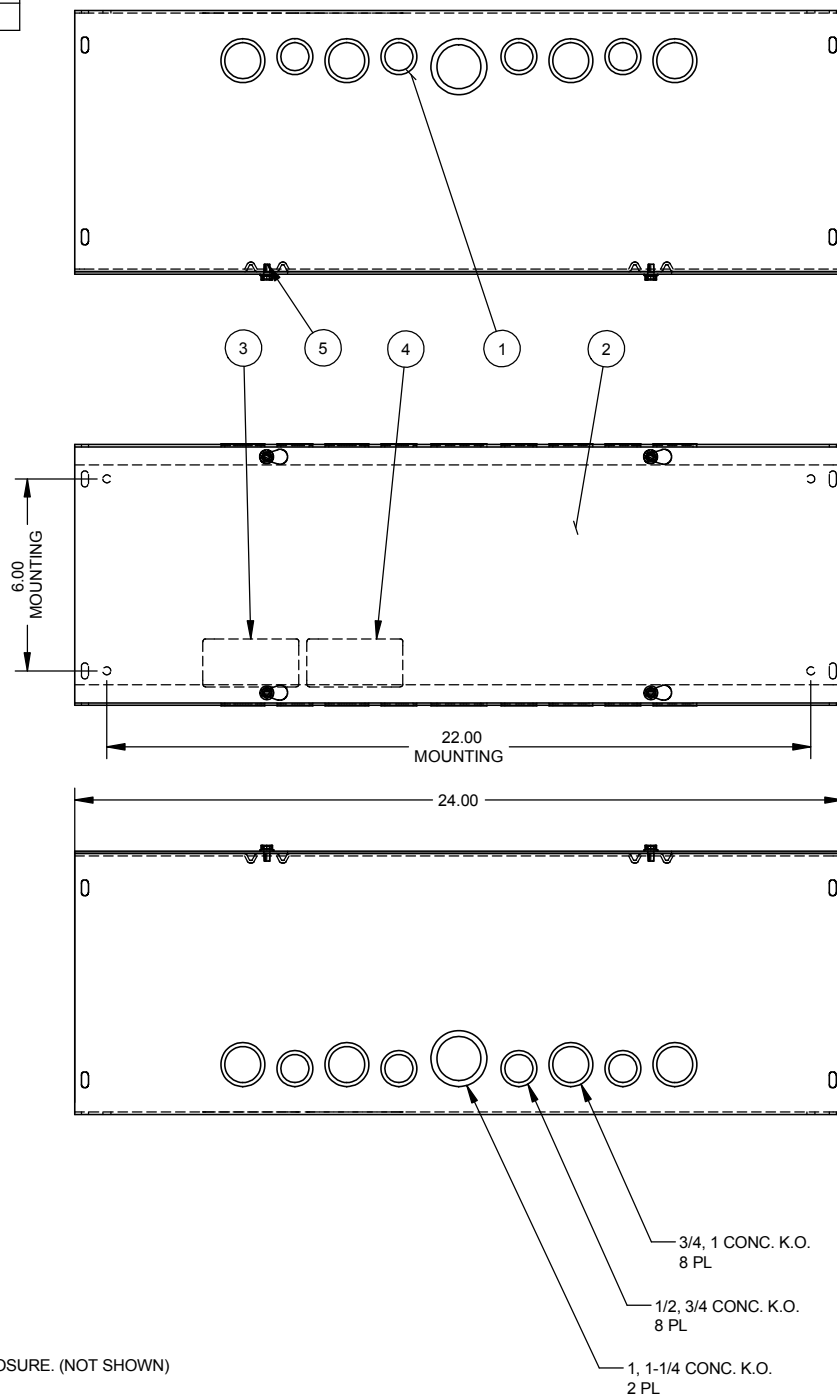

NOTE:
1. PLACE BAG ASSY INSIDE ENCLOSURE. (NOT SHOWN)


NO.	QTY.	PART NO.	DESCRIPTION
1	1	(SEE CHART)	BACK
2	1	(SEE CHART)	PLATE/COVER
3	1	(SEE CHART)	UL LABEL, WIREWAY
4	1	1002913	LABEL, RATING
5	4	1001290	SCREW, 10-32 X 5/16
6	2	1002880	BAG ASSY (NOT SHOWN)

SUFFIX	BACK #	COVER #
-SU	1001343	1003397
-SUC	1129038	1129031
-SO	1129039	1011824
-SUNK	1001327	1003397
-NK	1010694	1011824
-SUNKC	1129040	1129031

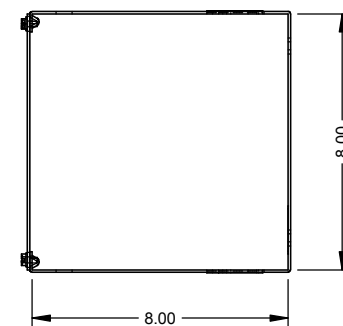

SUFFIX	FINISH
NONE	PAINTED
-NP	NOT PAINTED

D	2/17/14	UPDATED TO M2K WAS 255-11 eECR2718	AJS	C	8-29-07	ADDED BACK & COVER CHART ECO. 15946	DL	Scale:	NTS	Checked By:		Drawing No.:	1002637-11
B1	8-9-06	mECO #14958, ADDED NOTE #2.	CMW	C1	5/7/08	ADDED CHART & REMOVED NOTE#2(ECO.17139)	JLT	Drawn By:	DY	Approved By:		Date:	08/19/02

Material:	14 GA. - SEE CHART	 General Offices: Kansas City, MO	
Finish:	SEE CHART		
Tolerances: Unless Specified Otherwise X.X ±.1 X.XX ±.03 X.XXX ±.015 X" ±2"		Third Angle  Projection	
Title:	SCREW COVER WIREWAY 8 x 8 x 24, TYPE 1 NEMA ENCLOSURE		
Catalog No.:	(SEE CHART)		
Customer:	MILBANK STANDARD		
Date:	08/19/02	Sheet	1 of 1