




**Catalog Number:** 101012-GSC1-NK  
**Item Description:** N1 SCREW CVR GUTTER NK  
**UPC Code:** 784572157040

**Brand Name:** Milbank  
**Type:** Lay In Wireway  
**Application:** Wireway  
**Standard:** UL Listed, Type 1  
**Cover Type:** Screw Cover  
**Enclosure:** Indoor Enclosure  
**Nominal Cross Section:** 10x10  
**Straight Section Length:** 12  
**Material:** Steel with Powder Coat Finish  
**Finish:** ANSI 61 Gray  
**Knockouts:** False




*Utility requirements may vary. Always consult the serving utility for their requirements prior to ordering or installing this equipment. This product must always be installed by a licensed electrician. Installation of this equipment may require local electrical inspector approval.*




CATALOG#	LABEL#
101012-GSC1-NK	1002943
RC-101012-GSC1-NK	1125051
SPS-10101N	1132575



ITEM	QTY.	PART NUMBER	DESCRIPTION
1	1	(SEE CHART)	BACK
2	1	(SEE CHART)	PLATE/COVER
3	1	(SEE CHART)	UL LABEL, WIREWAY
4	1	1002885	LABEL, RATING
5	4	1001290	SCREW, 10-32 X 5/16
6	2	1002880	BAG ASSY (NOT SHOWN)

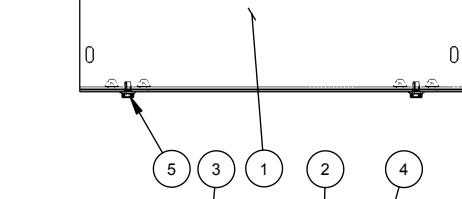

SUFFIX	BACK #	COVER #
-SU	1010751	1012193
-SUC	1129169	1119577
-SO	1129170	1129149
-SUNK	1129171	1012193
-NK	1129172	1129149
-SUNKC	1129173	1119577

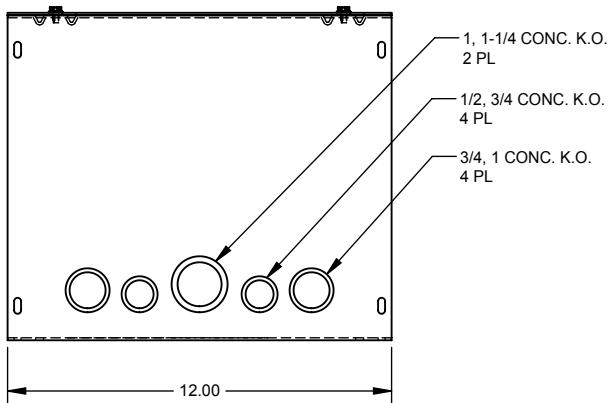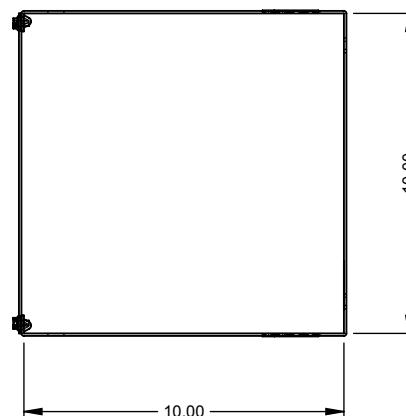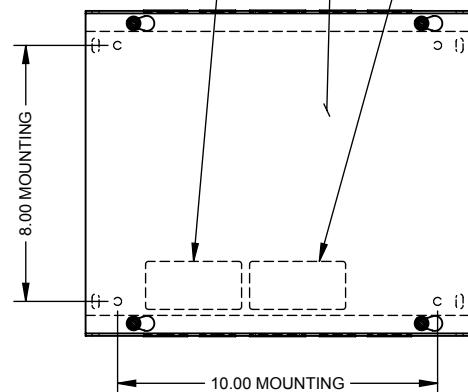

SUFFIX	FINISH
NONE	PAINTED
-NP	NOT PAINTED

NOTE:  
1. PLACE BAG ASS'Y INSIDE ENCLOSURE. (NOT SHOWN)

NEMA DWG.: #483

C	8-29-07	ADDED BACK & COVER CHART ECO. 15946	DL	C2	3/26/12	DWG NO. WAS 483 (ECO #22110)	D.F.	Scale:	NTS	Checked By:	
C1	6/4/08	ADDED CHART & REMOVED NOTE#2 (ECO.17139)	JLT	D	12/20/12	1002880 (2) WAS (3) (ECO #23335)	D.F.	Drawn By:	DY	Approved By:	

Material:	14 GA. - SEE CHART		
Finish:	SEE CHART		
Tolerances: Unless Specified Otherwise	X.X	$\pm .1$	Third Angle
	X.XX	$\pm .03$	Projection
	XXX	$\pm .015$	
	X"	$\pm 2^\circ$	
Catalog No.:	(SEE CHART)		
Customer:	MILBANK STANDARD		
Drawing No.:	1003619		
Date:	03/19/02	Sheet	1 of 1

**MILBANK**  
MANUFACTURING CO. General Offices:  
Kansas City, MO