
© 2020 ENTRELEC. All Rights Reserved.

| REVISIONS | | | | | |
|---|---|---|---|---|---|
| P | LTR | DESCRIPTION | DATE | DWN | APVD |
| | A | ECO-20-012219 | 21SEP2020 | GK | DR |

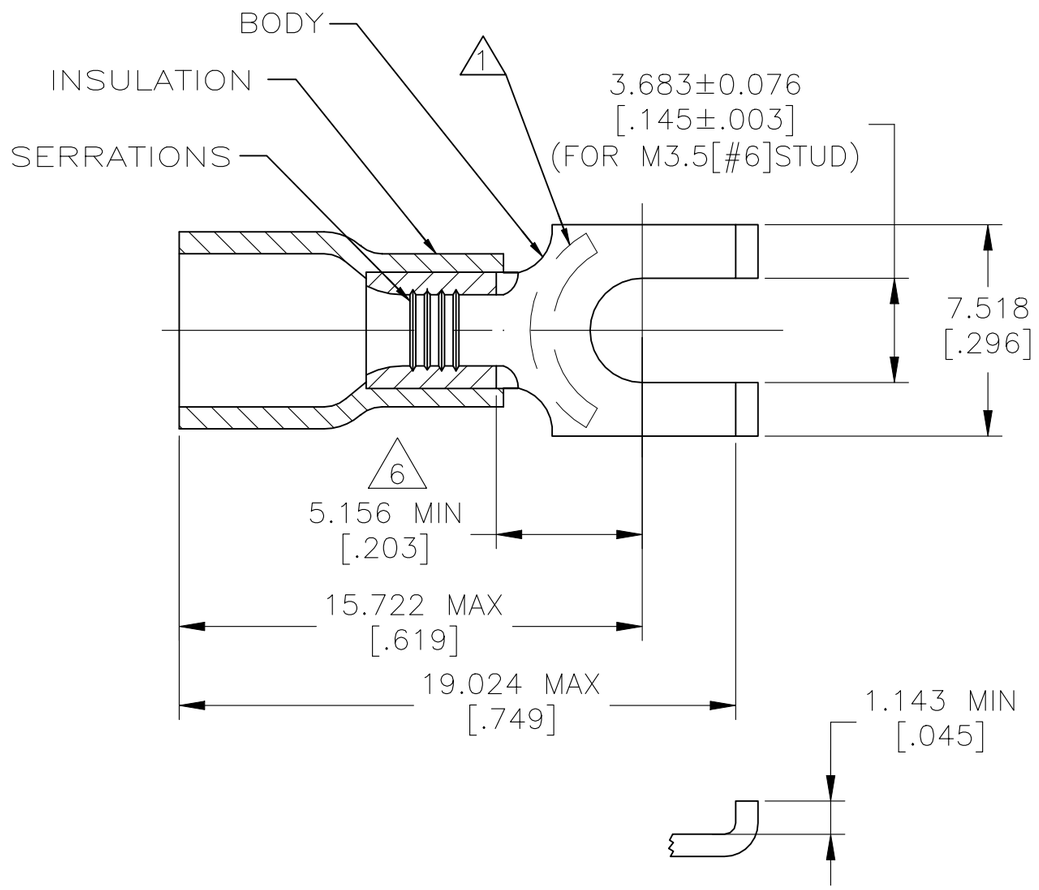


| Listed | Certified |
|---|---|
| 22-16 AWG SOLID OR STRANDED | 22-16 AWG SOLID OR STRANDED |

1. STAMP AMP 22-18* APPROX AS SHOWN WIRE RANGE IS 22-16 AWG
2. WIRE INSULATION DIAMETER: ø2.667- 3.556 [ø.105-.140]
3. BODY MATERIAL THK: 0.787±0.051 [.031±.002]
4. MATERIAL: BODY - CU PER ASTM B152
   INSULATION - PVC
5. FINISH: BODY - TIN PLATE 0.00254 [.000100] MIN EXT THK PER ASTM B545
   INSULATION COLOR - RED
6. APPLIES FROM EDGE OF METAL WIRE BARREL TO CENTER OF STUD HOLE

| QTY | DESIGNATION | ENTRELEC PN | TE PN |
|---|---|---|---|
| 100 | SDF015-035-V | 1SET132001R0000 | 322249 |

THIS DRAWING IS A CONTROLLED DOCUMENT.

MAX RECOMMENDED OPERATING TEMPERATURE: 105°C [221°F]

VOLTAGE RATING: 600V MAX (1000V FIXTURE OR SIGN)

CIRCULAR MIL AREA: 0.26-1.65mm² [509-3260] SOLID OR STRANDED

DIMENSIONS: mm [INCHES]

TOLERANCES UNLESS OTHERWISE SPECIFIED:

| | |
|---|---|
| 0 PLC | ± - |
| 1 PLC | ± - |
| 2 PLC | ± - |
| 3 PLC | ± 0.127[.005] |
| 4 PLC | ± - |
| ANGLES | ± - |

MATERIAL: 4

FINISH: - 5

| | | |
|---|---|---|
| DWN | GOPALAKRISHNA HV | 21SEP2020 |
| CHK | ROHDE DANIEL F | 21SEP2020 |
| APVD | ROHDE DANIEL F | 21SEP2020 |
| PRODUCT SPEC | UL 486A-B | |
| APPLICATION SPEC | 114-2161 | |
| WEIGHT | - | |

ENTRELEC Electrical Solutions

NAME: TERMINAL, SPADE, FLANGED, PLASTI-GRIP, WIRE SIZE: 22-16 AWG

| SIZE | CAGE CODE | DRAWING NO | RESTRICTED TO |
|---|---|---|---|
| A3 | 00779 | C-1SET132001R0000 | - |

CUSTOMER DRAWING

| SCALE | SHEET | REV |
|---|---|---|
| 6:1 | 1 OF 1 | A |