



REVISIONS					
P	LTR	DESCRIPTION	DATE	DWN	APVD
	A	ECO-20-012219	30NOV2020	GK	DR


	 Certified
12-10 AWG STRANDED	12-10 AWG STRANDED

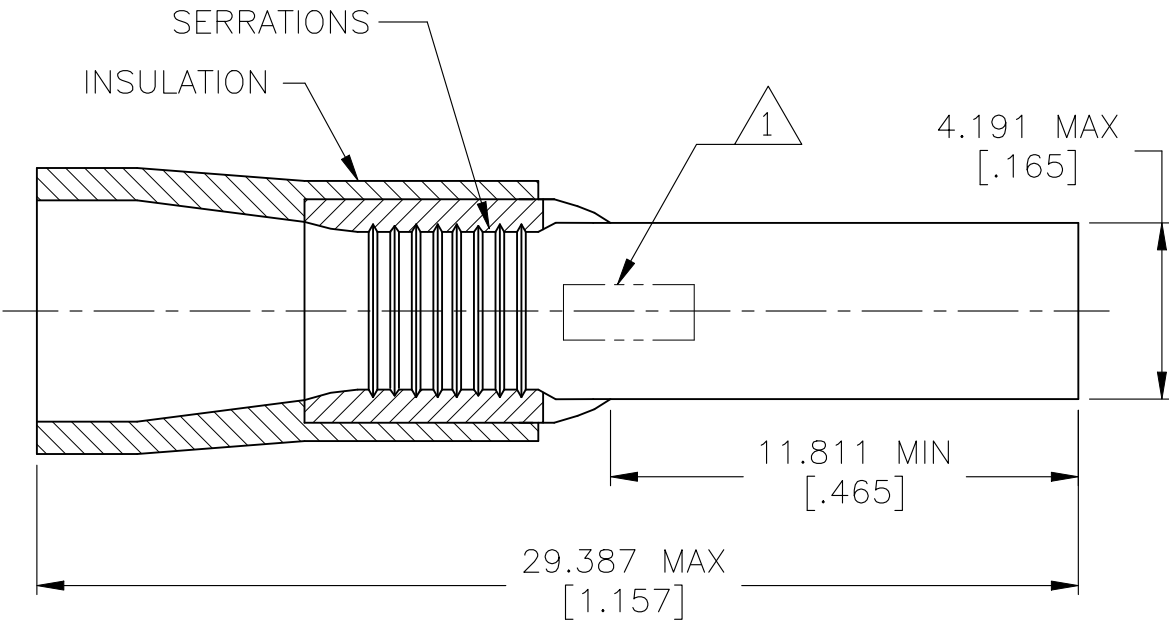

- 1 STAMP AMP 12-10 APPROX AS SHOWN
2. WIRE INSULATION DIAMETER: $\phi 3.784-6.400$ [$\phi .149-.252$]
3. BODY MATERIAL THK: 1.016 ± 0.051 [$.040 \pm .002$]
- 4 MATERIAL: BODY - COPPER PER ASTM B152
INSULATION - PVC
- 5 FINISH: BODY - TIN PLATE 0.00254 [$.000100$] MIN EXT THK PER ASTM B545
INSULATION COLOR - YELLOW

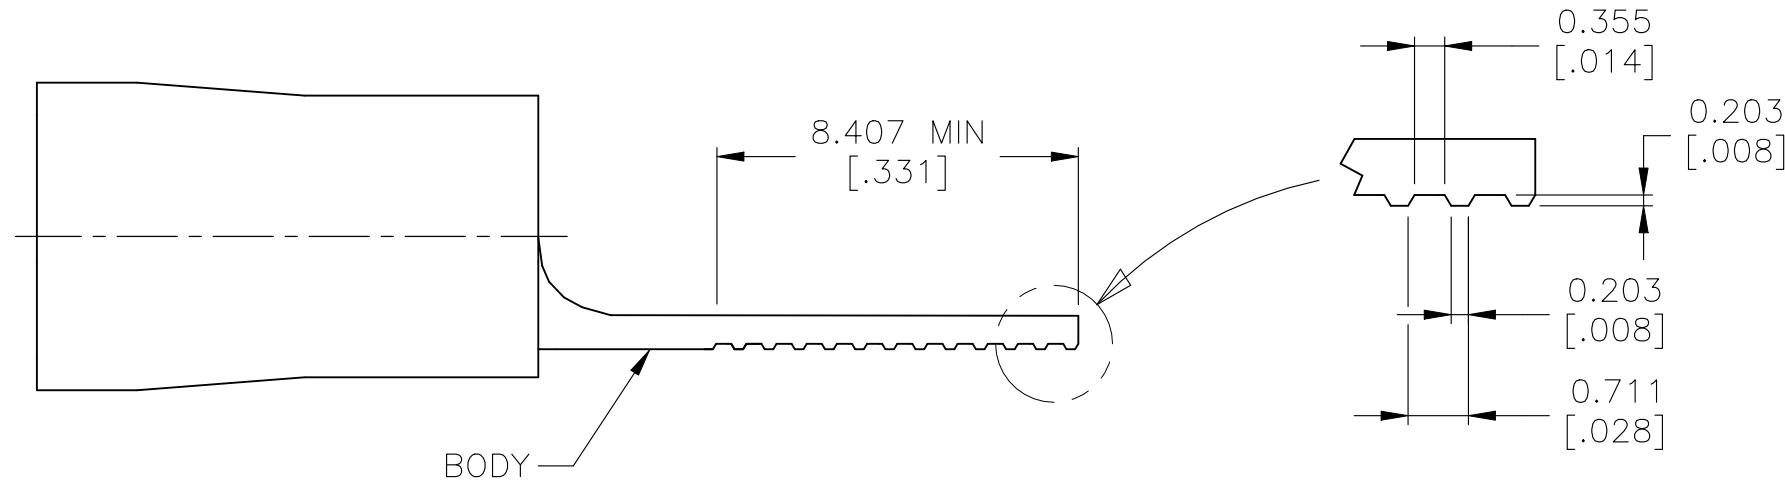

100	WPF060-V	1SET152003R0000	131445
QTY	DESIGNATION	ENTRELEC PN	TE PN

	THIS DRAWING IS A CONTROLLED DOCUMENT.		DWN 30NOV2020 GOPALAKRISHNA HV		ENTRELEC Electrical Solutions									
			CHK 30NOV2020 ROHDE DANIEL F											
MAX RECOMMENDED OPERATING TEMPERATURE: 105°C [221°F]	DIMENSIONS: mm [INCHES]		TOLERANCES UNLESS OTHERWISE SPECIFIED: 0 PLC ± - 1 PLC ± - 2 PLC ± - 3 PLC ± 0.127[.005] 4 PLC ± - ANGLES ± 1°		APVD 30NOV2020 ROHDE DANIEL F		NAME TERMINAL, TAB, PLASTI-GRIP, 12-10 AWG							
					PRODUCT SPEC UL 486A-B									
VOLTAGE RATING: 600 V MAX					APPLICATION SPEC 114-2161		SIZE		CAGE CODE	DRAWING NO	RESTRICTED TO			
	WEIGHT -				A3		00779	C-1SET152003R0000						
CIRCULAR MIL AREA: 2.62-6.64mm² [5,180-13,100] STRANDED	MATERIAL 		FINISH 		CUSTOMER DRAWING				SCALE	5:1	SHEET	1 OF 1	REV	A