
© 2020 ENTRELEC. All Rights Reserved.

REVISIONS					
P	LTR	DESCRIPTION	DATE	DWN	APVD
	A	ECO-20-012219	22SEP2020	GK	DR

Listed	Certified
16-14 AWG SOLID OR STRANDED	16-14 AWG SOLID OR STRANDED

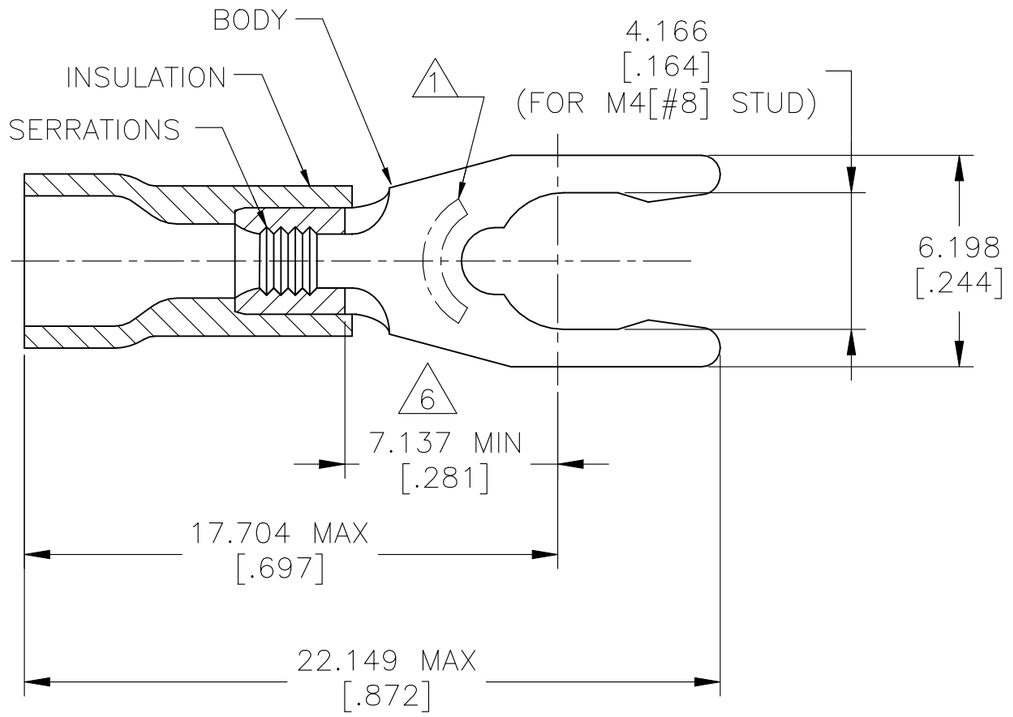

1. STAMP 8S AMP 16-14* APPROX AS SHOWN
2. WIRE INSULATION DIAMETER: ø2.997- 4.902 [ø.118-.193]
3. BODY MATERIAL THK: 0.787±0.051 [.031±.002]
4. MATERIAL: BODY - BRASS PER ASTM B36
   INSULATION - PVC
5. FINISH: BODY - TIN PLATE 0.00254 [.000100] MIN EXT THK PER ASTM B545
   INSULATION COLOR - BLUE
6. APPLIES FROM EDGE OF METAL WIRE BARREL TO CENTER OF STUD HOLE

QTY	DESIGNATION	ENTRELEC PN	TE PN
100	SDS025-040-V	1SET133007R0000	53244-1

MAX RECOMMENDED OPERATING TEMPERATURE: 105°C [221° F]

VOLTAGE RATING: 600V MAX (1000V FIXTURE OR SIGN)

CIRCULAR MIL AREA: 1.04-2.62mm² [2,050-5,180] SOLID OR STRANDED

THIS DRAWING IS A CONTROLLED DOCUMENT.

DIMENSIONS: mm [INCHES]

TOLERANCES UNLESS OTHERWISE SPECIFIED:

0 PLC	± -
1 PLC	± -
2 PLC	± -
3 PLC	± 0.127[.005]
4 PLC	± -
ANGLES	± -

MATERIAL 4

FINISH - 5

DWN	22SEP2020 GOPALAKRISHNA HV
CHK	22SEP2020 ROHDE DANIEL F
APVD	22SEP2020 ROHDE DANIEL F
PRODUCT SPEC	UL 486A-B
APPLICATION SPEC	114-2161
WEIGHT	-

ENTRELEC Electrical Solutions

NAME: TERMINAL, SPRING SPADE, SHORT, PLASTI-GRIP, WIRE SIZE: 16-14 AWG

SIZE	CAGE CODE	DRAWING NO	RESTRICTED TO
A3	00779	C-1SET133007R0000	-

CUSTOMER DRAWING

SCALE	SHEET	REV
6:1	1 OF 1	A