
© 2020 TE Connectivity. All Rights Reserved.

REVISIONS					
P	LTR	DESCRIPTION	DATE	DWN	APVD
	A	ECO-20-012219	18NOV2020	GK	DR

Listed	Certified
12 AWG STRANDED	12-10 AWG SOLID OR STRANDED

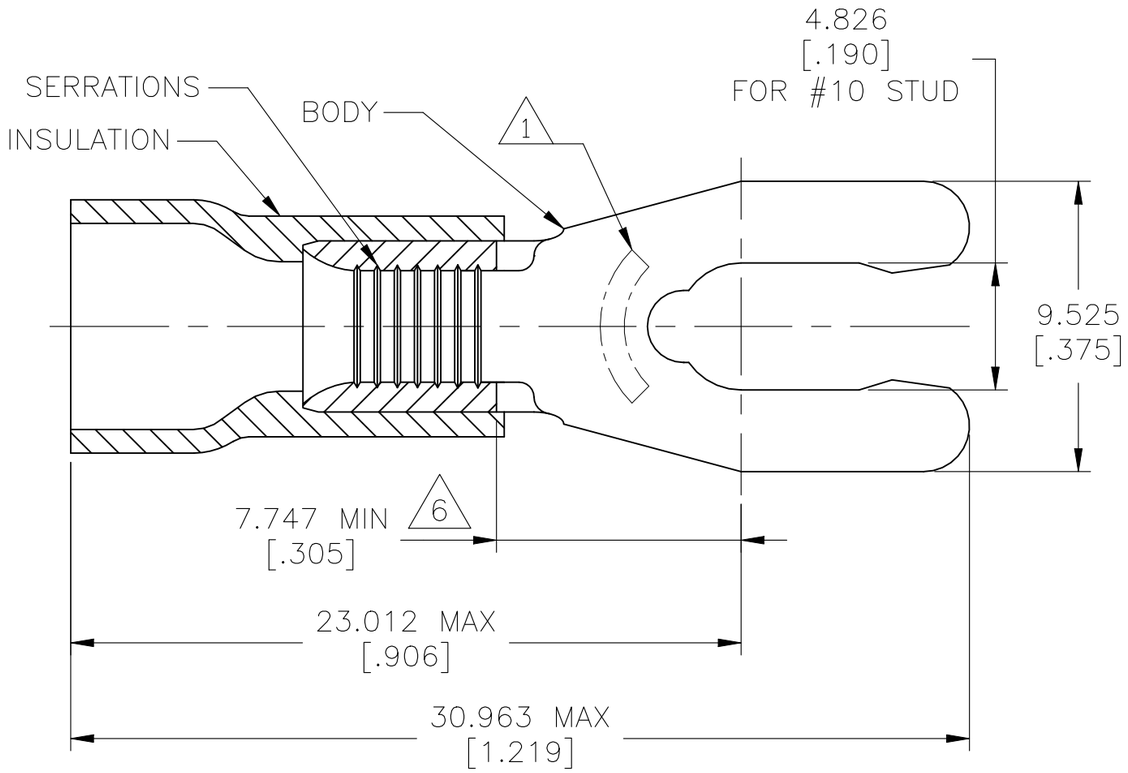

1 STAMP 10S AMP 12-10* APPROX AS SHOWN

2. WIRE INSULATION DIAMETER: ø2.670-5.080 [ø.105-.200]

3. BODY MATERIAL THK: 1.016±0.051 [.040±.002]

4 MATERIAL: BODY - BRASS PER ASTM B36
INSULATION - PVC

5 FINISH: BODY - TIN PLATE 0.00254 [.000100] MIN EXT THK PER ASTM B545
INSULATION COLOR - YELLOW

6 APPLIES FROM EDGE OF METAL WIRE BARREL TO CENTER OF STUD HOLE

QTY	DESIGNATION	ENTRELEC PN	TE PN
100	SDL060-050-V	1SET134008R0000	52475

THIS DRAWING IS A CONTROLLED DOCUMENT.

MAX RECOMMENDED OPERATING TEMPERATURE:	105°C [221°F]
VOLTAGE RATING:	600V MAX (1000V FIXTURE OR SIGN)
CIRCULAR MIL AREA:	2.62-6.64mm² [5,180-13,100] SOLID OR STRANDED

DIMENSIONS: mm [INCHES]

TOLERANCES UNLESS OTHERWISE SPECIFIED:

0 PLC	± -
1 PLC	± -
2 PLC	± -
3 PLC	± 0.127[.005]
4 PLC	± -
ANGLES	± -

MATERIAL - 4

FINISH - 5

DWN	18NOV2020 GOPALAKRISHNA HV
CHK	18NOV2020 ROHDE DANIEL F
APVD	18NOV2020 ROHDE DANIEL F
PRODUCT SPEC	UL 486A-B
APPLICATION SPEC	114-2161
WEIGHT	-

ENTRELEC
Electrical Solutions

NAME
TERMINAL, SPRING SPADE,
LONG, PLASTI-GRIP,
WIRE SIZE : 12-10 AWG

SIZE	CAGE CODE	DRAWING NO	RESTRICTED TO
A3	00779	C-1SET134008R0000	-

CUSTOMER DRAWING

SCALE	SHEET	REV
6:1	1 OF 1	A