
© 2020 TE Connectivity. All Rights Reserved.

REVISIONS					
P	LTR	DESCRIPTION	DATE	DWN	APVD
	A	ECO-20-012219	13NOV2020	GK	DR

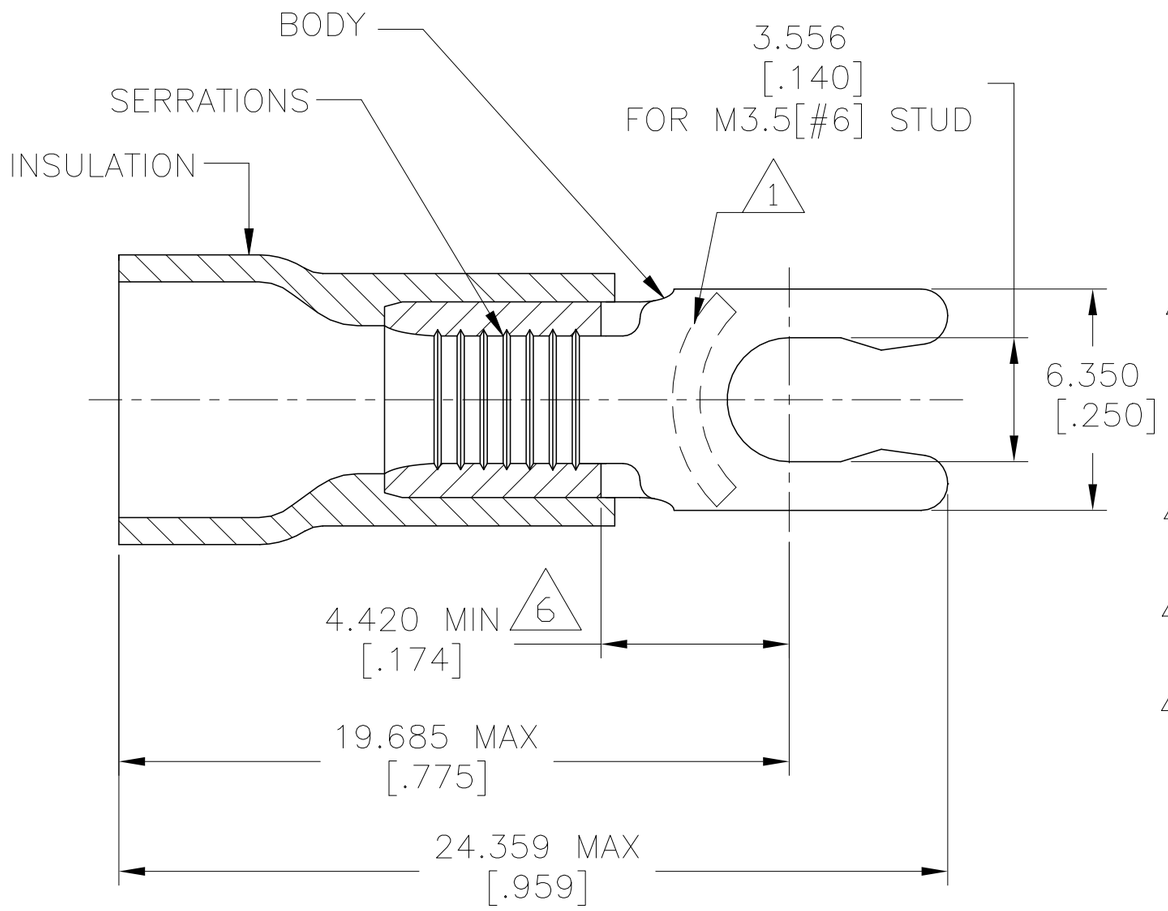

Listed	Certified
12 AWG STRANDED	12-10 AWG SOLID OR STRANDED

1. STAMP 6SAMP 12-10* APPROX AS SHOWN
2. WIRE INSULATION DIAMETER: ø2.667- 5.080 [ø.105-.200]
3. BODY MATERIAL THK: 1.016±0.051 [.040±.002]
4. MATERIAL: BODY - BRASS PER ASTM B36
   INSULATION - PVC
5. FINISH: BODY - TIN PLATE 0.00254 [.000100] MIN EXT THK PER ASTM B545
   INSULATION COLOR - YELLOW
6. APPLIES FROM EDGE OF METAL WIRE BARREL TO CENTER OF STUD HOLE

100	SDS060-035-V	1SET133009R0000	52961
QTY	DESIGNATION	ENTRELEC PN	TE PN

MAX RECOMMENDED OPERATING TEMPERATURE: 105°C [221°F]

VOLTAGE RATING: 600V MAX (1000V FIXTURE OR SIGN)

CIRCULAR MIL AREA: 2.62-6.64mm² [5,180-13,100] SOLID OR STRANDED

THIS DRAWING IS A CONTROLLED DOCUMENT.

DIMENSIONS: mm [INCHES]

TOLERANCES UNLESS OTHERWISE SPECIFIED:
0 PLC ± -
1 PLC ± -
2 PLC ± -
3 PLC ± 0.127[.005]
4 PLC ± -
ANGLES ± -

MATERIAL 4

FINISH 5

DWN 13NOV2020 GOPALAKRISHNA HV
CHK 13NOV2020 ROHDE DANIEL F
APVD 13NOV2020 ROHDE DANIEL F
PRODUCT SPEC UL 486A-B
APPLICATION SPEC 114-2161
WEIGHT -

CUSTOMER DRAWING

ENTRELEC Electrical Solutions

NAME: TERMINAL, SPRING SPADE, SHORT, PLASTI-GRIP WIRE SIZE 12-10 AWG

SIZE	CAGE CODE	DRAWING NO	RESTRICTED TO
A3	00779	C-1SET133009R0000	-

SCALE	SHEET	REV
6:1	1 OF 1	A