
© 2020 ENTRELEC. All Rights Reserved.

REVISIONS					
P	LTR	DESCRIPTION	DATE	DWN	APVD
	A	ECO-20-012219	22SEP2020	GK	DR

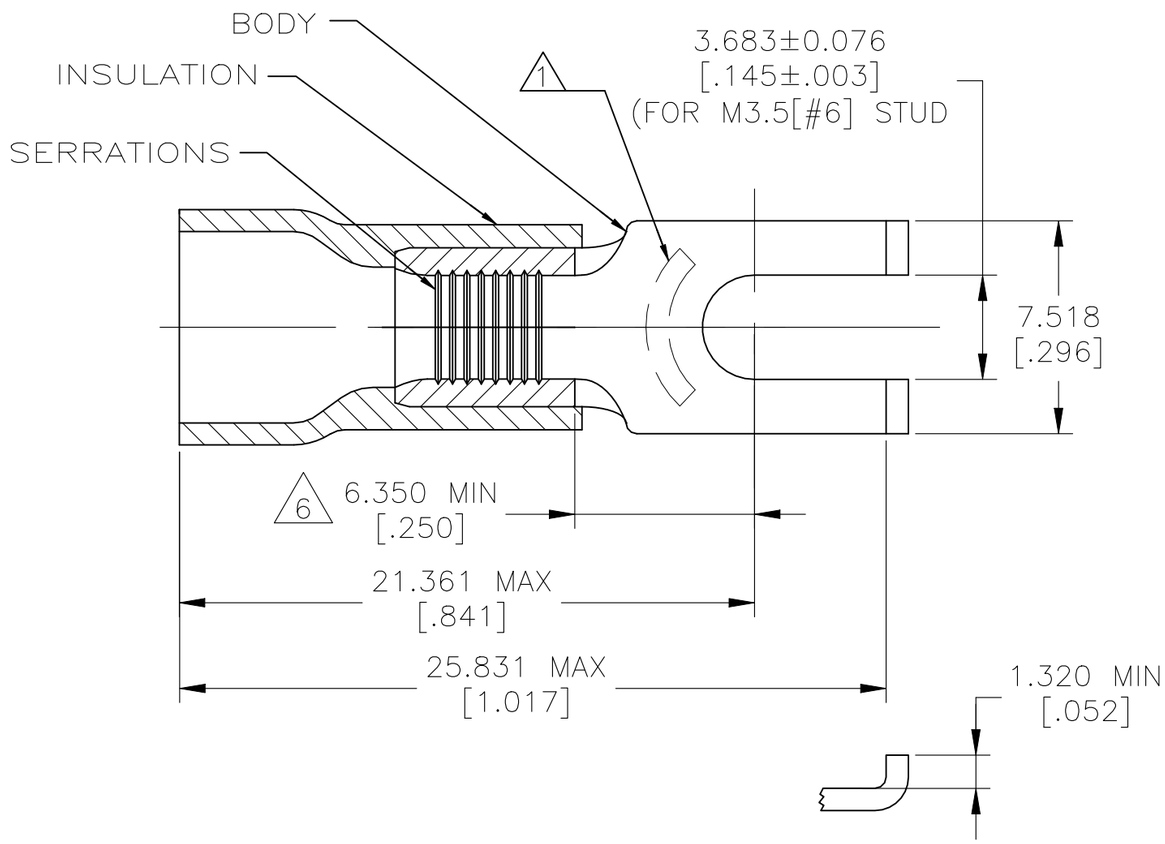

Listed	Certified
12-10 AWG SOLID OR STRANDED	12-10 AWG SOLID OR STRANDED

1. STAMP AMP 12-10* APPROX AS SHOWN
2. WIRE INSULATION DIAMETER: ø3.810- 6.350 [ø.150-.250]
3. BODY MATERIAL THK: 0.991±0.051 [.039±.002]
4. MATERIAL: BODY - CU PER ASTM B152
   INSULATION - PVC
5. FINISH: BODY - TIN PLATE 0.00254 [.000100] MIN EXT THK PER ASTM B545
   INSULATION COLOR - YELLOW
6. APPLIES FROM EDGE OF METAL WIRE BARREL TO CENTER OF STUD HOLE

QTY	DESIGNATION	ENTRELEC PN	TE PN
100	SDF060-035-V	1SET132007R0000	324581

THIS DRAWING IS A CONTROLLED DOCUMENT.

MAX RECOMMENDED OPERATING TEMPERATURE: 105°C [221°F]

VOLTAGE RATING: 600V MAX (1000V FIXTURE OR SIGN)

CIRCULAR MIL AREA: 2.62-6.64mm² [5,180-13,100] SOLID OR STRANDED

DIMENSIONS: mm [INCHES]

TOLERANCES UNLESS OTHERWISE SPECIFIED:

0 PLC	± -
1 PLC	± -
2 PLC	± -
3 PLC	± 0.127[.005]
4 PLC	± -
ANGLES	± -

MATERIAL 4

FINISH 5

DWN	GOPALAKRISHNA HV	22SEP2020
CHK	ROHDE DANIEL F	22SEP2020
APVD	ROHDE DANIEL F	22SEP2020
PRODUCT SPEC	UL 486A-B	
APPLICATION SPEC	114-2161	
WEIGHT	-	

ENTRELEC Electrical Solutions

NAME: TERMINAL, SPADE, FLANGED, PLASTI-GRIP, WIRE SIZE: 12-10 AWG

SIZE	CAGE CODE	DRAWING NO	RESTRICTED TO
A3	00779	C-1SET132007R0000	-

CUSTOMER DRAWING

SCALE	SHEET	REV
6:1	1 OF 1	A

1470-19 (1/15)