

Auxiliary switch kit in Magnum low voltage circuit breakers

⚠ WARNING

(1) ONLY QUALIFIED ELECTRICAL PERSONNEL SHOULD BE PERMITTED TO WORK ON THE EQUIPMENT.
 (2) ALWAYS DE-ENERGIZE PRIMARY AND SECONDARY CIRCUITS IF A CIRCUIT BREAKER CANNOT BE REMOVED TO A SAFE WORK LOCATION.
 (3) DRAWOUT CIRCUIT BREAKERS SHOULD BE LEVERED (RACKED) OUT TO THE DISCONNECT POSITION.
 (4) ALL CIRCUIT BREAKERS SHOULD BE SWITCHED TO THE OFF POSITION AND MECHANISM SPRINGS DISCHARGED.
 FAILURE TO FOLLOW THESE STEPS FOR ALL PROCEDURES DESCRIBED IN THIS INSTRUCTION LEAFLET COULD RESULT IN DEATH, BODILY INJURY, OR PROPERTY DAMAGE.

Section 1: General information

An auxiliary switch is an optional device providing remote electrical indication if the circuit breaker is open or closed. Up to three auxiliary switches can be mounted in the circuit breaker. Each switch has two normally open ("A") and two normally closed ("B") contacts for a total of 12 available contacts.

Section 2: Installation of the auxiliary switch

To install the auxiliary switch, proceed with the following five steps:

Step 1: Remove the front cover by unscrewing the hex head captive bolts (four for three-pole, six for four-pole) that join the cover to the breaker housing using a 10 mm 1/4-inch drive socket. Then hold the charge handle down approximately 45 degrees to pull off the cover.

Step 2: Place the appropriate label on the front cover nameplate space located under "Accessories."

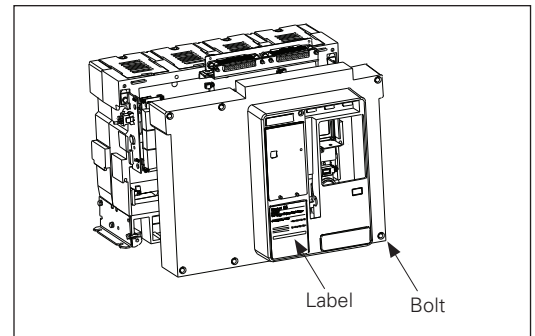


Figure 1. Steps 1 and 2

Step 3: Slide the lock on the switch to the unlocked (up) position. Install the hook feet down through openings as shown. Then slide the auxiliary switch forward so the feet engage the mounting plate. Slide the lock down into the locked position.

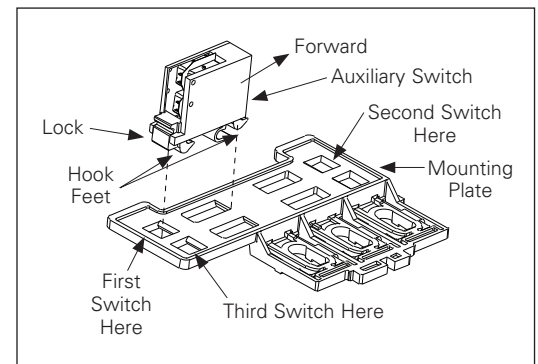


Figure 2. Step 3

Note: The number of auxiliary switches and shunt trips cannot exceed four.

EATON

Powering Business Worldwide

Step 4: Wire auxiliary switches per **Table 1** and wire markings.

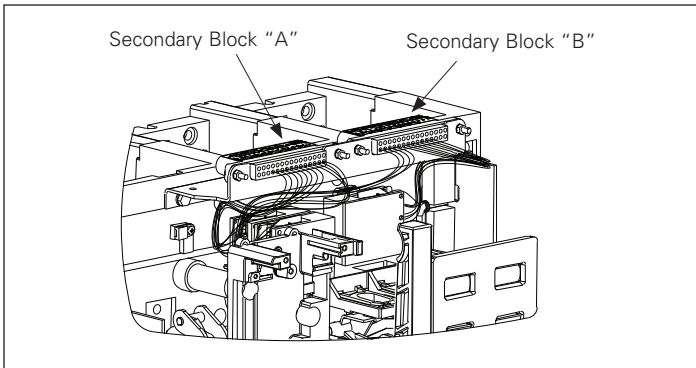


Figure 3. Step 4

Note: Securely tie wires away from moving parts.

Table 1. Auxiliary Switch Secondary Wiring

Auxiliary Switch	Standard/Double Frame Breaker	Narrow Frame Breaker
#1	Contacts B20–B27	Contacts B20–B27
#2	Contacts A27–A30, B16–B19	Contacts A19–A26
#3	Contacts A19–A26	—

Step 5: Reinstall front cover removed in Step 1.

Disclaimer of warranties and limitation of liability

The information, recommendations, descriptions, and safety notations in this document are based on Eaton Corporation's ("Eaton") experience and judgment, and may not cover all contingencies. If further information is required, an Eaton sales office should be consulted.

Sale of the product shown in this literature is subject to the terms and conditions outlined in appropriate Eaton selling policies or other contractual agreement between Eaton and the purchaser.

THERE ARE NO UNDERSTANDINGS, AGREEMENTS, WARRANTIES, EXPRESSED OR IMPLIED, INCLUDING WARRANTIES OF FITNESS FOR A PARTICULAR PURPOSE OR MERCHANTABILITY, OTHER THAN THOSE SPECIFICALLY SET OUT IN ANY EXISTING CONTRACT BETWEEN THE PARTIES. ANY SUCH CONTRACT STATES THE ENTIRE OBLIGATION OF EATON. THE CONTENTS OF THIS DOCUMENT SHALL NOT BECOME PART OF OR MODIFY ANY CONTRACT BETWEEN THE PARTIES.

In no event will Eaton be responsible to the purchaser or user in contract, in tort (including negligence), strict liability, or otherwise for any special, indirect, incidental, or consequential damage or loss whatsoever, including but not limited to damage or loss of use of equipment, plant or power system, cost of capital, loss of power, additional expenses in the use of existing power facilities, or claims against the purchaser or user by its customers resulting from the use of the information, recommendations, and descriptions contained herein.

The information contained in this manual is subject to change without notice.

Eaton Corporation
Electrical Sector
1000 Cherrington Parkway
Moon Township, PA 15108
United States
877-ETN-CARE (877-386-2273)
Eaton.com

© 2009 Eaton Corporation
All Rights Reserved
Printed in USA
Publication No. IL2C14766H03 / Z8696
June 2009



PowerChain Management is a registered trademark of Eaton Corporation.

All other trademarks are property of their respective owners.